

## Receiver

Society  
Reference  
Address  
Phone  
Fax  
E-mail

## From

**Pump model:** S4-3/9 M 230 V 4GG

**Hydraulic Part Code :** 60196433

4GG 0,55 kW 230 V M

**Motor Code :** 60122740

Inverter application : Allowed - min. 30Hz

### Pump data

P2 nominal requested : 0,55 kW

Min. fluid temperature : 0 °C

Max. fluid temperature : 40 °C

Max. Permitted amount of sand : 150 g/m<sup>3</sup>

### Requested data

Flow :

Head :

Fluid : Water

Fluid Temperature : 20 °C

Density : 998,3 kg/m<sup>3</sup>

Kinematic viscosity : 1,005 mm<sup>2</sup>/s

Vapor pressure : 2,34 kPa

### Hydraulic data (duty point)

Flow :

Head :

Efficiency :

NPSH :

P2 nominal requested :

### Materials

Lower support Precision Cast Steel AISI 304

Impeller Technopolymer

Diffuser Technopolymer

Screws Stainless Steel AISI 304

Cable sheath Stainless Steel AISI 304

Shaft with coupling Stainless Steel AISI 420

Filter Stainless Steel AISI 304

### Motor data

Motor type : 4GG

Nominal power P2 : 0,55 kW

Rated voltage : 1~ 230 V 50 Hz



Nominal current : 4,6 A

Number of poles : 2

Rated speed : 2.820 1/min

Degree of protection : IP 68

### Curve tolerance according to ISO 9906

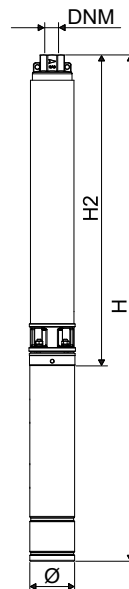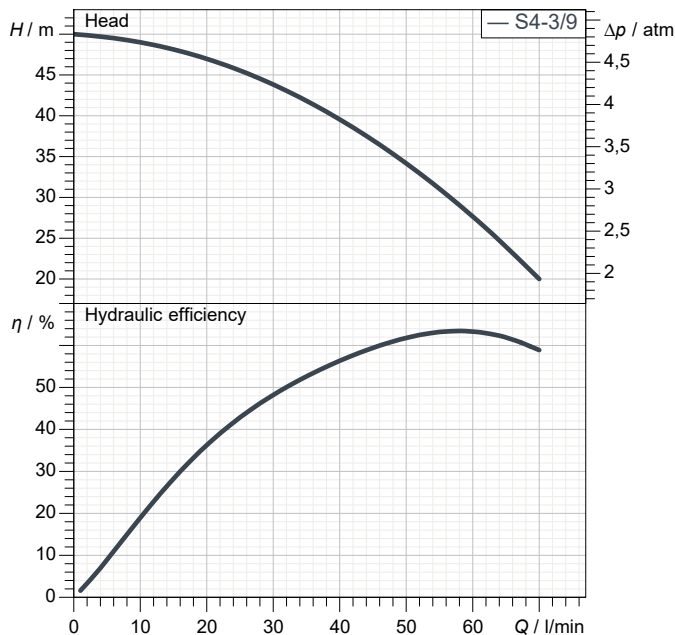

**Weight :** 12,1 kg

### Dimensions in mm

|     |           |  |  |  |  |
|-----|-----------|--|--|--|--|
| DNM | 1"1/4 G-F |  |  |  |  |
| H   | 712       |  |  |  |  |
| H2  | 446       |  |  |  |  |
| Ø   | 99        |  |  |  |  |

### Pump connection


Discharge side : 1 " 1/4 G-F

Receiver

From

Society  
Reference  
Address  
Phone  
Fax  
E-mail

### Installation example without inverter

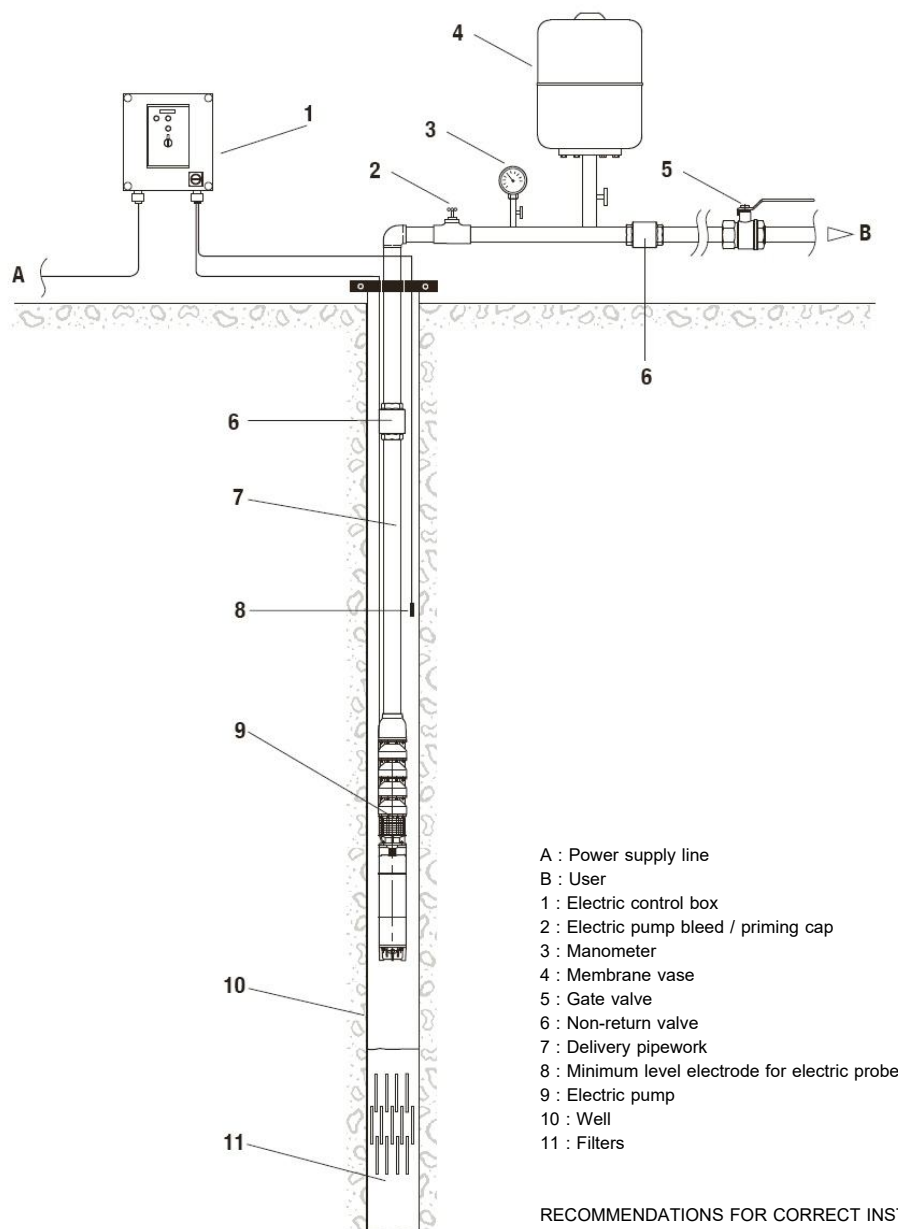

#### RECOMMENDATIONS FOR CORRECT INSTALLATION


- Keep a minimum distance of one metre from the bottom of the well.
- Install a non-return valve at least 10 metres from the delivery outlet of the pump.
- Install further non-return valves at 30-40 metre intervals.
- Ensure a minimum cooling flow around the motor during operation (for further information refer to the motor technical data sheet).
- Ensure that the dynamic level of the water in the well is at least one metre above the pump delivery

Receiver

From

Society  
Reference  
Address  
Phone  
Fax  
E-mail

### Installation example with inverter

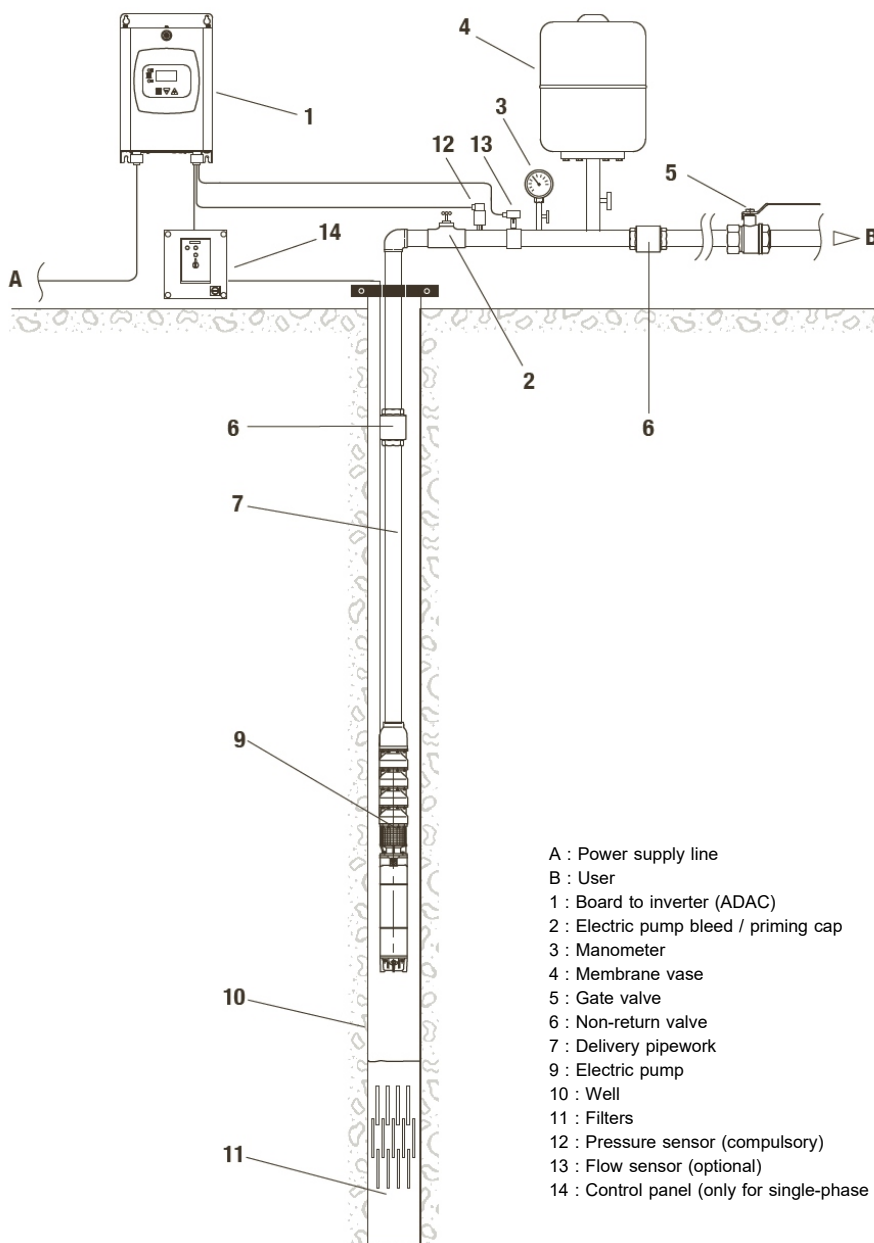

- A : Power supply line  
B : User  
1 : Board to inverter (ADAC)  
2 : Electric pump bleed / priming cap  
3 : Manometer  
4 : Membrane vase  
5 : Gate valve  
6 : Non-return valve  
7 : Delivery pipework  
9 : Electric pump  
10 : Well  
11 : Filters  
12 : Pressure sensor (compulsory)  
13 : Flow sensor (optional)  
14 : Control panel (only for single-phase version, for capacitor housing)

#### RECOMMENDATIONS FOR CORRECT INSTALLATION

- Keep a minimum distance of one metre from the bottom of the well.
- Install a non-return valve at least 10 metres from the delivery outlet of the pump.
- Install further non-return valves at 30-40 metre intervals.
- Ensure a minimum cooling flow around the motor during operation (for further information refer to the motor technical data sheet).
- Ensure that the dynamic level of the water in the well is at least one metre above the pump delivery


Receiver

From

Society  
Reference  
Address  
Phone  
Fax  
E-mail

## S4-3/9 M 230 V 4GG

Curve tolerance according to ISO 9906

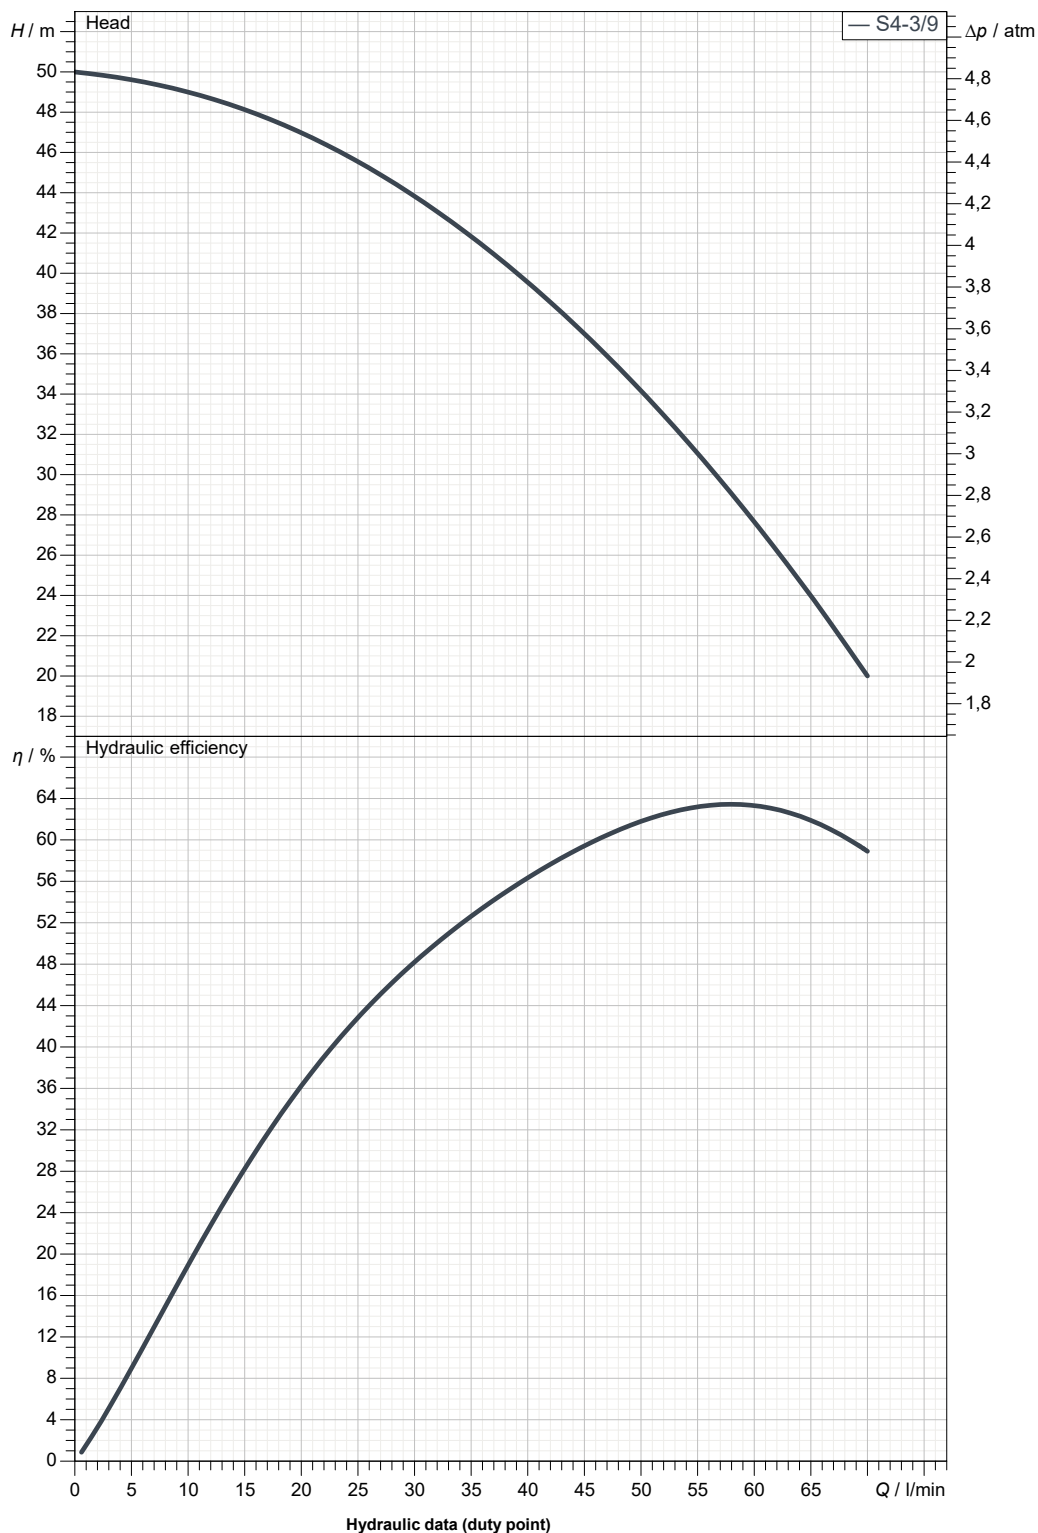

Suction side :

Discharge side :  
1" 1/4 G-F  
--

Flow :

Head :

Rated speed :  
2.820 1/min

MAIN\_PROJECT\_TITLE

BUSINESS\_PROCESS\_IT

OWNER\_

ISSUE\_DATE

2020-05-23



# DIMENSIONAL DRAWING

2020-05-23

Page 5 / 5


DAB PUMPS S.p.A.  
Via Marco Polo, 14 - 35035 Mestrino (PD), Italy  
Tel. +39 049 5125000 - Fax +39 049 5125950  
www.dabpumps.com

Receiver

From

Society  
Reference  
Address  
Phone  
Fax  
E-mail

S4-3/9 M 230 V 4GG

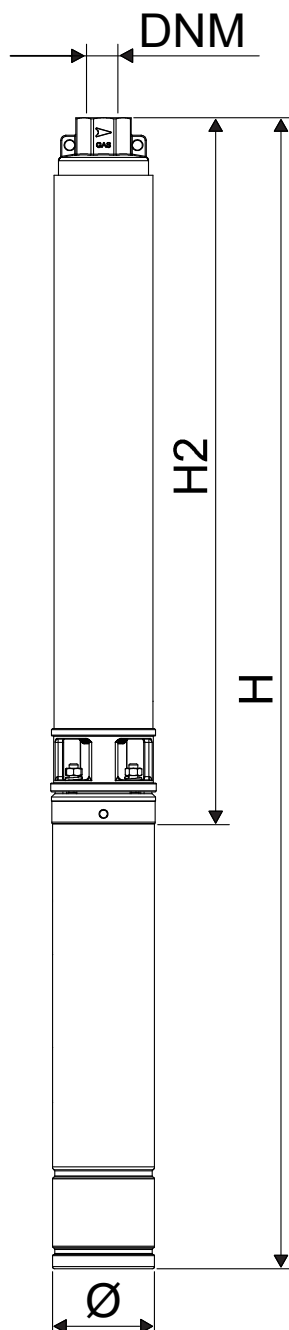

Dimensions in mm

Pump connection

|    |     |           |  |  |  |  |  |  |            |
|----|-----|-----------|--|--|--|--|--|--|------------|
| 1  | DNM | 1"1/4 G-F |  |  |  |  |  |  |            |
| 2  | H   | 712       |  |  |  |  |  |  | Suction    |
| 3  | H2  | 446       |  |  |  |  |  |  |            |
| 4  | Ø   | 99        |  |  |  |  |  |  |            |
| 5  |     |           |  |  |  |  |  |  |            |
| 6  |     |           |  |  |  |  |  |  |            |
| 7  |     |           |  |  |  |  |  |  | Discharge  |
| 8  |     |           |  |  |  |  |  |  | 1" 1/4 G-F |
| 9  |     |           |  |  |  |  |  |  | --         |
| 10 |     |           |  |  |  |  |  |  |            |
| 11 |     |           |  |  |  |  |  |  |            |
| 12 |     |           |  |  |  |  |  |  |            |

MAIN\_PROJECT\_TITLE

BUSINESS\_PROCESS\_IC

OWNER\_

ISSUE\_DATE

2020-05-23